





**City of Pomona  
Building Division**

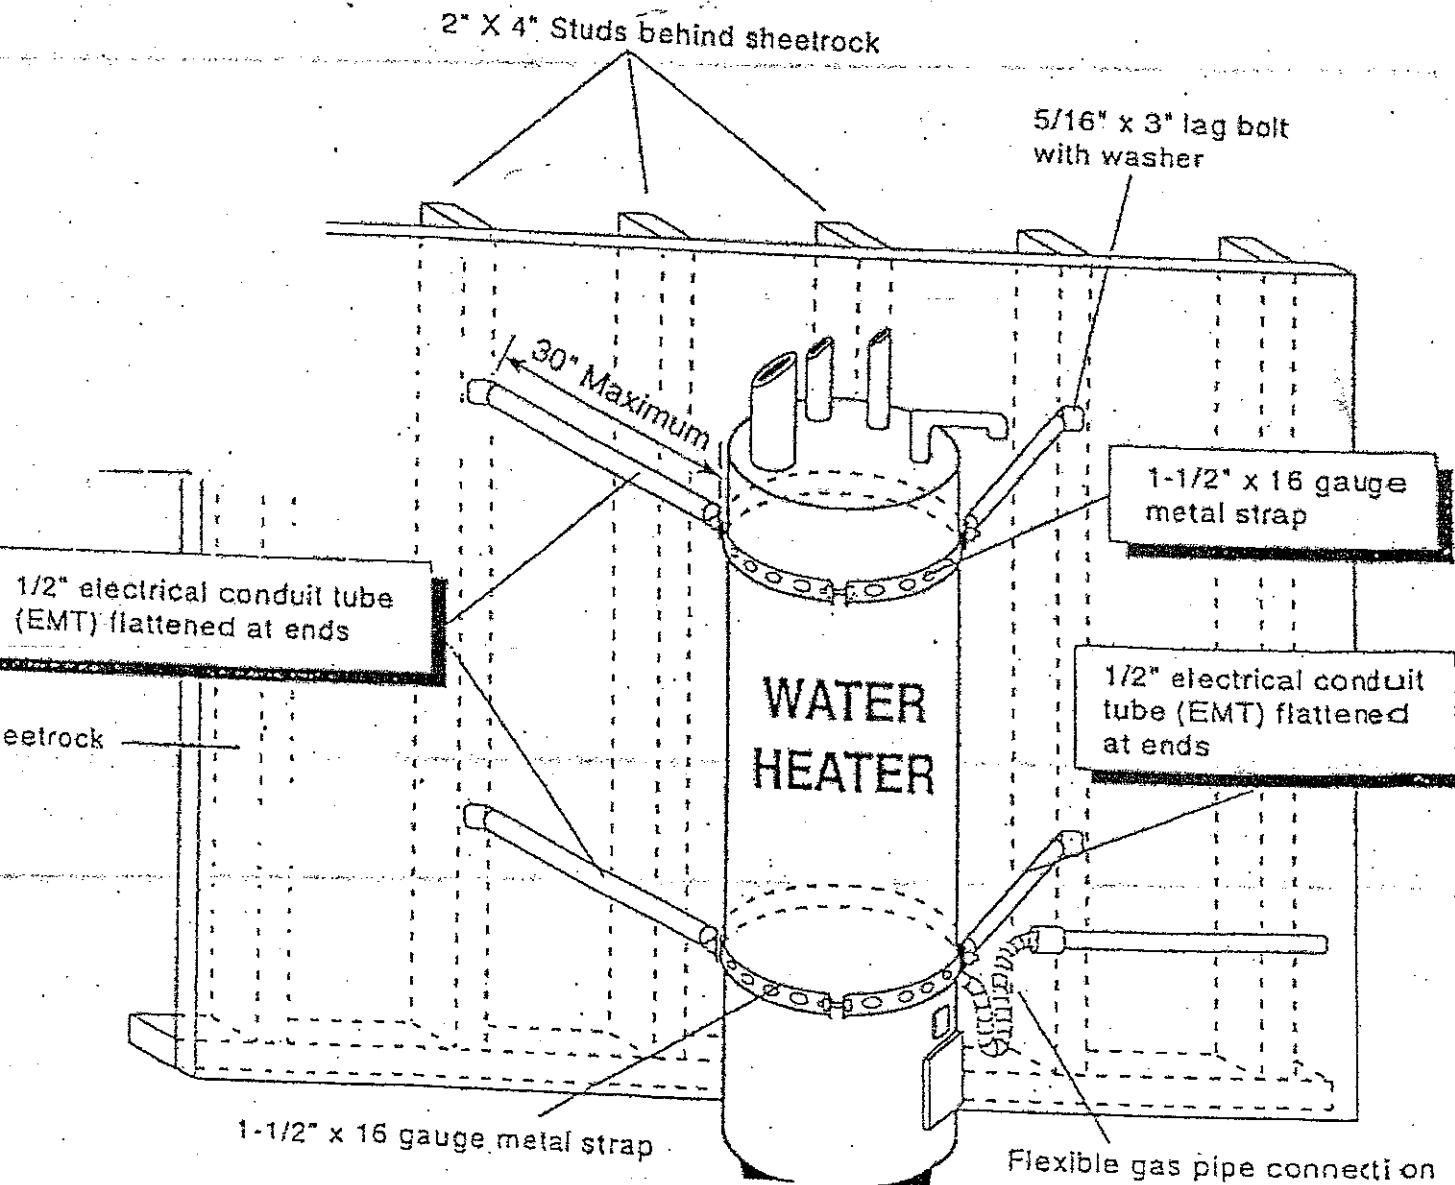

## TEMPERATURE AND PRESSURE RELIEF VALVE

## PRESSURE RELIEF VALVE

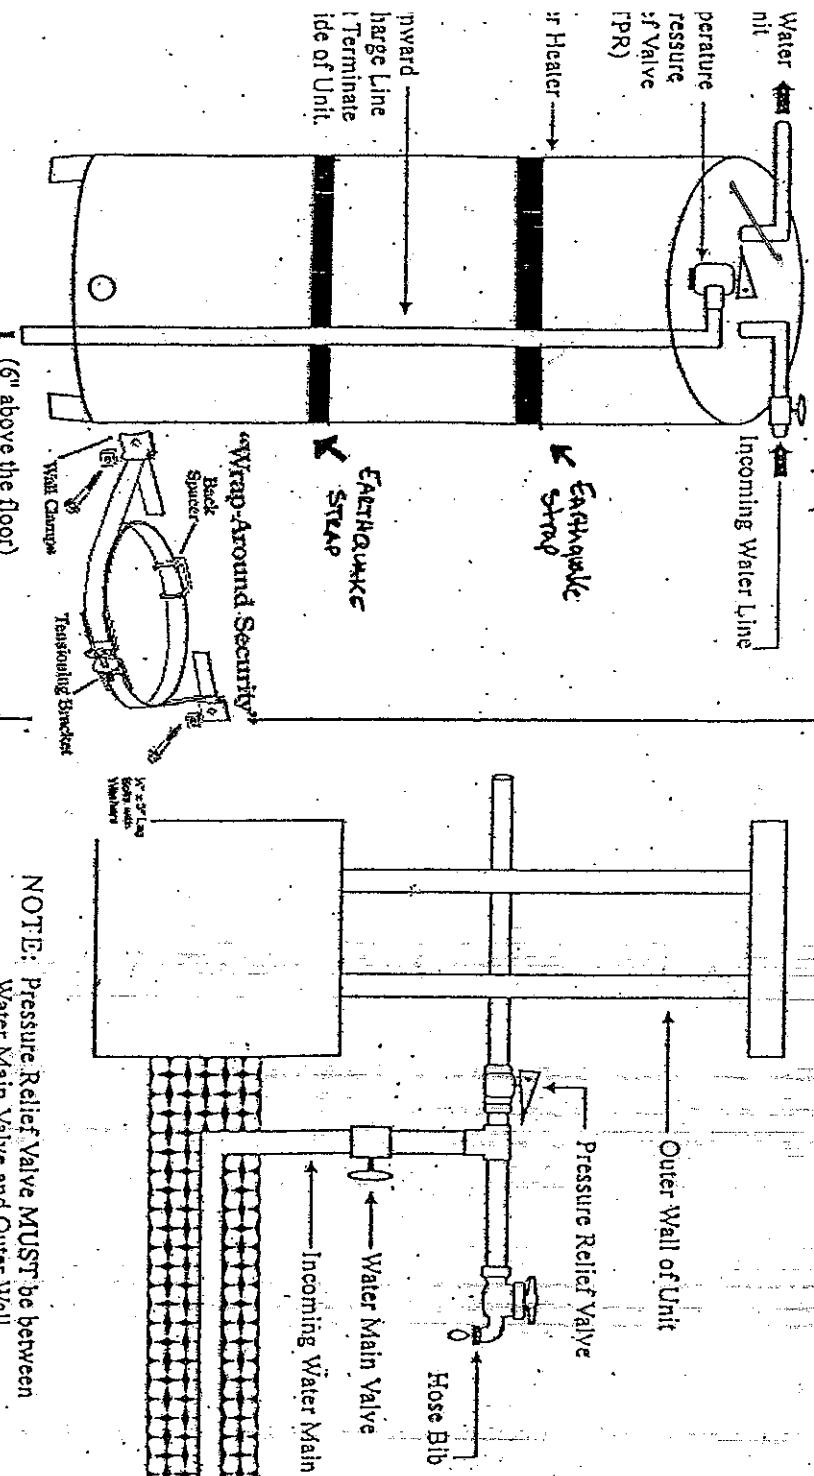

**NOTE:** Pressure Relief Valve MUST be between Water Main Valve and Cistern Well

The PR (Pressure Relief) Valve may be used in lieu a TPR Valve when the water heater has an ECO Device built in. Usually heaters under 15 years of age have an ECO Device built in.

The Uniform Plumbing Code (UPC), section 510.5 says, "In seismic zones 3 and 4, water heaters shall be anchored or strapped to resist horizontal displacement due to earthquake motion. Strapping shall be at points within the upper one-third (1/3) and lower one-third (1/3) of its vertical dimensions. At the lower point, a minimum of four (4) inches (102mm) shall be maintained above the controls with the strapping."

eed EARTHQUAKE STRAPS?